


20 Year Warranty Certificate

R1.0 Thermally Rated Flexible Duct

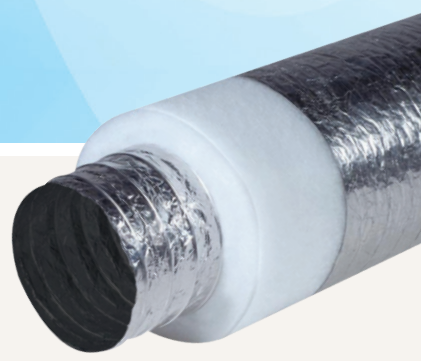

National Air Parts 20 (twenty) year warranty covers all R1.0 flexible ducting against manufacturing defects and the breakdown of materials through natural aging.

Home owner details

Name:

Address:

.....

Post Code:

Phone Number:

I have read and agree to all warranty and claim conditions as stated.

Signed:

Date:

This is to certify that National Air Parts flexible ducting when assembled using a 400gm/sm polyester fibre will achieve a thermal rating of R1.0

Installer Details

Company Name:

Address:

.....

Phone Number:

License No.:

Signed:

Install Date:.....

This 20 (twenty) year warranty is conditional on all components being of National Air Parts manufacture.

Your comfort is our commitment

PO Box 40, Cobbitty NSW 2570
Ph: 02 4648 1022 Fax: 02 4648 1033
National Air Parts is a 100% Australian owned and operated company



Official Test Certificate




National Air Parts flexible duct has been tested and has passed all requirements of AS 4254 - 1995 AMDT.1 - 1996 and UL 181 for use in domestic and commercial Air Handling Systems.

Product name and description

- Polyflex R1.0 Flexible Duct

Test	Description of Test	Result
UL 181.9	Burn Test	Complies
UL 181.12	Temperature Test	Complies
UL 181.13	Puncture Test	Complies
UL 181.14	Static Load Test	Complies
UL 181.15	Impact Test	Complies
UL 181.17	Pressure Test	Complies
UL 181.18	Collapse Test	Complies
UL 181.19	Tension Test	Complies
UL 181	Mould Growth & Humidity Test	Complies
AS 1530.3	AS 1530.3 - 1989 AMDT.1 - 1992	Complies

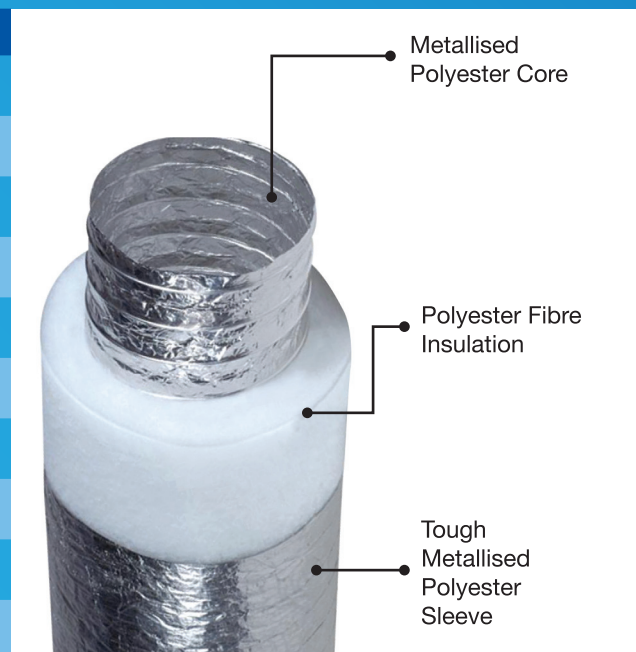

ALL TESTS IN ACCORDANCE WITH AS 4254-1995 AMDT. 1-1996 TESTED BY AWTEXTILE TESTING Insulation code AS 4859.1
All thermal data provided by Martini Industries PTY LTD.

Full set of test certificates are available on request.

TERMS AND CONDITIONS

This warranty covers National Air Parts Pty Ltd (NAP) insulated and uninsulated flexible ducting.

The flexible ducting must be installed in accordance with NAP procedures and incorporates associated HVAC components and products supplied by NAP.

The warranty covers only the affected portion of the installation and is limited to replacement of parts only. Removal and re-installation costs are not included.

The warranty will only apply if appropriate flexible duct support mechanisms are in place, in either ceiling or underfloor applications, and the flexible ducting is taped correctly to all connections.

This warranty does not cover damage caused by birds, animals, insects or acts of God, misuse, abuse, or negligence.

NAP flexible ducting needs to be stored or installed in a dry environment. Warranty will be void if damage occurs in exposed weather conditions, direct sunlight or damp environments.

Warranty claims will only be recognised if:

- The warranty certificate is completed at the time of installation and certificate details are forwarded to NAP within one month of installation.

- Claims are inspected by NAP representatives in situ, and no changes to the original installation have occurred.

The warranty applies only to the original purchase.

Warranty will be rendered void if installed by an unlicensed installer.